


**CONSTRUCTION NOTES**

- SEE STANDARD FIG. 5-395.101(A) AND FIG. 5-395.101(B) FOR ADDITIONAL DIMENSIONS AND CONSTRUCTION NOTES.
- USE CONCRETE MIX NO. 3W82 WITH NO CALCIUM CHLORIDE ALLOWED.
- ON ALL END SECTIONS FOR WATERWAYS, USE DROPWALLS ON INLET AND OUTLET ENDS.
- SEE STANDARD FIG. 5-395.115 FOR EMBANKMENT PROTECTION.
- FINISH ALL EXPOSED EDGES OF CONCRETE WITH 1/2" OR 3/4" CHAMFER OR RADIUS UNLESS OTHERWISE NOTED.
- WITH DOUBLE BOXES LOCATE DROPWALL JOINTS BETWEEN END SECTIONS. SEE STANDARD FIG. 5-395.111 FOR ALTERNATE DROPWALLS. LIMITS OF EXCAVATION FOR DROPWALL ARE APPROXIMATELY THE SAME AS DROPWALL DIMENSIONS. DROPWALL CONCRETE MIX IS 3S52, OR 3Y82 IF PRECAST. FURNISHING AND INSTALLATION OF DROPWALL TO BE INCLUDED IN PRICE BID FOR END SECTIONS. DROPWALL NOT REQUIRED FOR NON-WATERWAY USE.
  - CHECK LOCATION TO DETERMINE WHETHER A TONGUE OR A GROOVE IS USED.
  - SEE STANDARD FIG. 5-395.104(B) FOR LINTEL BEAM DETAILS.
  - FILL HOLE WITH GROUT. GROUT CONSISTS OF 1 PART CEMENT AND 2 PARTS SAND. USE TYPE 1A AIR ENTRAINED PORTLAND CEMENT. GROUT MIX MAXIMUM SLUMP IS 4".
  - 2" DIAMETER HOLE, 6" DEEP IN TOP OF THE SECTION WALL.
  - 3'-6" MIN. TONGUE AND 3'-7" MIN. GROOVE FOR CULVERTS WITH 6'-0" SPANS. 5'-0" MIN. TONGUE AND 5'-1" MIN. GROOVE FOR CULVERTS WITH SPANS GREATER THAN 6'-0". CENTER TONGUE AND GROOVE ON C OF EACH APRON JOINT. TONGUE AND GROOVE JOINT ON ALL THREE SIDES OF APRON IS PERMISSIBLE.
  - AS AN ALTERNATE TO THE ONE LAYER WELDED WIRE REINFORCEMENT, PROVIDE TWO LAYERS OF REBAR OR WELDED WIRE REINFORCEMENT WITH THE STEEL AREA EQUAL TO HALF OF THE TEMPERATURE STEEL PER CODE REQUIREMENTS IN EACH FACE OF THE DROPWALL.
  - APRON TOP AND BOTTOM SLAB THICKNESS MAY BE 8" FOR CULVERTS WITH 6' SPANS ONLY. BOTTOM SLAB THICKNESS MAY BE INCREASED UP TO 2" MAX. PROVIDED CONCRETE COVER IS 1/2" MIN., 2" MAX.
  - PLACE LONGITUDINAL REINFORCEMENT PERPENDICULAR TO THE CULVERT SPAN WITH A MINIMUM OF 0.06 SQUARE INCHES PER PERIPHERAL FOOT ON ALL FACES OF THE BARREL.


**PLAN VIEW**  
SOME REINFORCEMENT NOT SHOWN

**SECTION A-A**

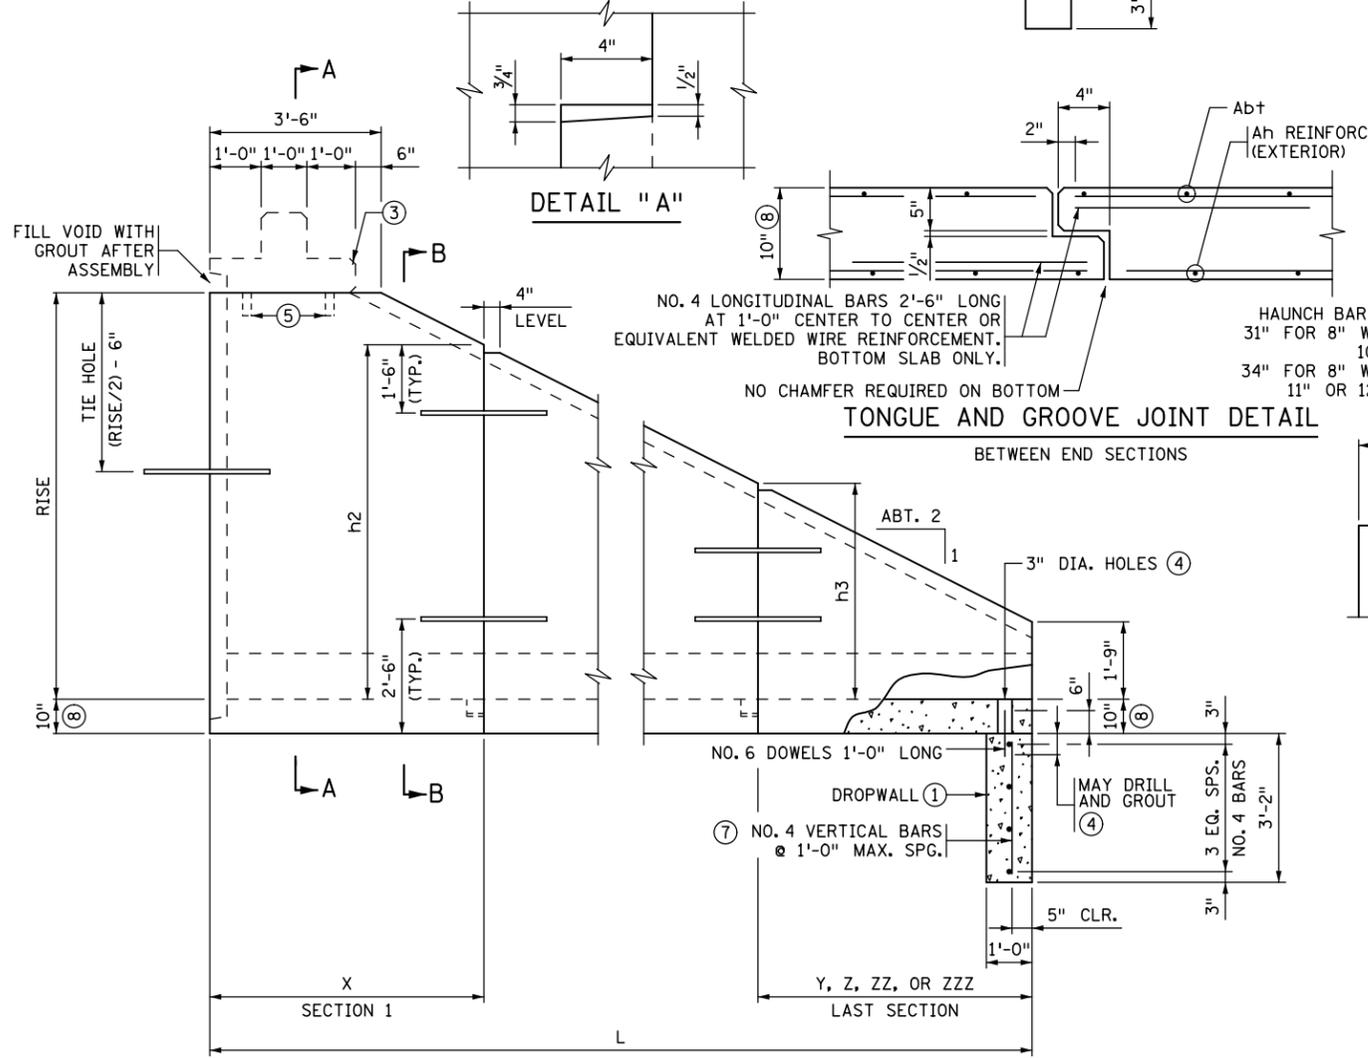


**DETAIL "A"**

**TONGUE AND GROOVE JOINT DETAIL**  
BETWEEN END SECTIONS

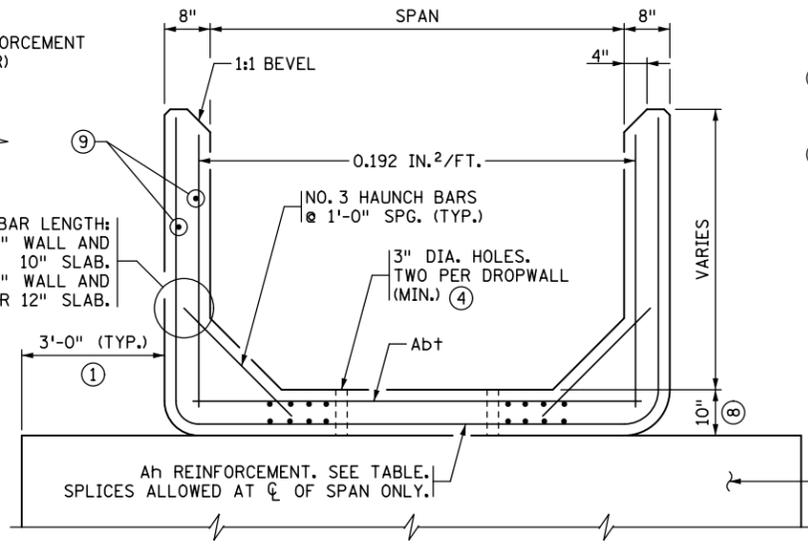

**SECTION B-B**

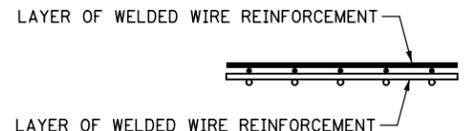

**REINFORCEMENT LAYER DETAIL**  
WHEN MORE THAN ONE LAYER OF WELDED WIRE REINFORCEMENT IS USED TO OBTAIN THE REQUIRED REINFORCEMENT AREAS, PLACE THE WIRES OF THE WELDED WIRE REINFORCEMENT AS SHOWN.

**Abt REINFORCEMENT**

SPAN (FT.)	Abt (IN <sup>2</sup> /FT.)
6-10	0.20
12	0.30
14	0.39
16	0.39

**APRON DIMENSIONS & Ah REINFORCEMENT**

RISE FT.	L FT.	SECTION 1		SECTION 2		SECTION 3		SECTION 4		SECTION 5		h6				
		X	Ah	h2	Y	Ah	h3	Z	Ah	h4	ZZ		Ah			
4	8	8' (4')	0.192	1'-9" (3'-9")	(4)	(0.192)	(1'-9")									
5	10	6'	0.192	3'-9"	4'	0.192	1'-9"									
6	12	6'	0.192	4'-9"	6'	0.192	1'-9"									
7	14	6'	0.192	5'-9"	8' (4')	0.192	1'-9" (3'-9")	(4')	(0.192)	(1'-9")						
8	16	6'	0.20	6'-9"	6'	0.192	3'-9"	4'	0.192	1'-9"						
9	18	6'	0.29	7'-9"	6'	0.20	4'-9"	6'	0.192	1'-9"						
10	20	6'	0.42	8'-9"	6'	0.29	5'-9"	8' (4')	0.192	1'-9" (3'-9")	(4)	(0.192)	(1'-9")			
11	22	6'	0.60	9'-9"	6'	0.42	6'-9"	6'	0.192	3'-9"	4'	0.192	1'-9"			
12	24	6'	0.78	10'-9"	6'	0.60	7'-9"	6'	0.20	4'-9"	6'	0.192	1'-9"			
13	26	6'	1.03	11'-9"	6'	0.78	8'-9"	6'	0.28	5'-9"	8' (4')	0.192	1'-9" (3'-9")	(4)	(0.192)	(1'-9")
14	28	6'	1.38	12'-9"	6'	1.03	9'-9"	6'	0.40	6'-9"	6'	0.192	3'-9"	4'	0.192	1'-9"

NOTE: Ah IS AREA OF REINFORCEMENT PER FOOT OF LENGTH (IN<sup>2</sup>/FT.)  
VALUES IN ( ) MAY BE USED FOR END SECTIONS WITH SPANS OF 14' AND 16' ONLY.

REVISION: 10-09-2015  
APPROVED: MARCH 24, 2011  
*Nancy Subenberger*  
STATE BRIDGE ENGINEER

STATE PROJ. NO - (T.H.) STA. + . FIG. 5-395.104(A)

CERTIFIED BY \_\_\_\_\_ DATE \_\_\_\_\_ TITLE: PRECAST CONCRETE END SECTION TYPE III - SINGLE OR DOUBLE BARREL FOR SKEWS UP TO 7 1/2'

DES: \_\_\_\_\_ DR: \_\_\_\_\_ APPROVED: \_\_\_\_\_  
CHK: \_\_\_\_\_ CHK: \_\_\_\_\_

NAME: \_\_\_\_\_ LIC. NO. \_\_\_\_\_ SHEET NO. OF SHEETS BRIDGE NO.